



Project: _____

Item: _____

Quantity: _____

Date: _____

Models	Length
☐ DI-FT454-25-18-T/H	22"
☐ DI-FT454-25-36-T/H	40"
☐ DI-FT454-25-54-T/H	58"
☐ DI-FT454-18-26-T/H	30"
☐ DI-FT454-18-52-T/H	56"
☐ DI-FT454-18-78-T/H	82"

DI-FT454-25-54-T/H



U.L. Sanitation Classified to NSF Standards

- Use in high volume operations
- Perfect for use with portioned items
- Sanitary easy to clean stainless surface

Standard Features

- ✓ Full sealing gasket
- ✓ 6 standard sizes
- ✓ 6' cord and plug
- ✓ 120V, 60, 1PH
- ✓ Rubber bar mat included
- ✓ 5° Hugged Edge (H)

Optional Features (Specify)

- ☐ Turned Down Edge (T)
- ☐ Skirt Mounted Control Adapter (Must Specify)


Installation Requirements

Below are the minimum standards for equipment installation of refrigerated drop-ins to perform at optimum levels and maintain warranty coverage.


- Maximum condenser incoming air temperature 86°F
- Maximum cavity air temperature: 100°F
- Minimum intake & discharge air louver opening area: 60 in² (.42 ft²)
- Minimum air flow across condenser: 145 cfm
- Recommended minimum proximity condenser to louver: <2 in

Refer to our technical service bulletin ([link](#)) for drawings and more details on ideal installation examples as well as suggestions on the use of supplemental ventilation fans.


☐ 90° 1/2" Turned Down Edge



☐ 5° Hugged Edge



Muffin Fan / Cut Out

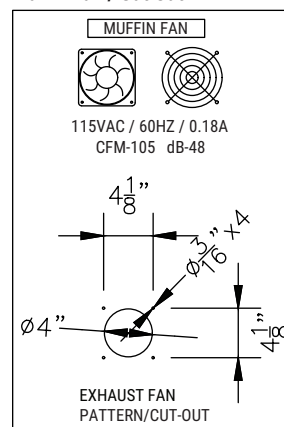


REV 6/19/26




LTI, Inc.
1947 Bill Casey Parkway
Jonesboro, GA 30236
(888) 584-2722
lowtempind.com

Approvals: _____

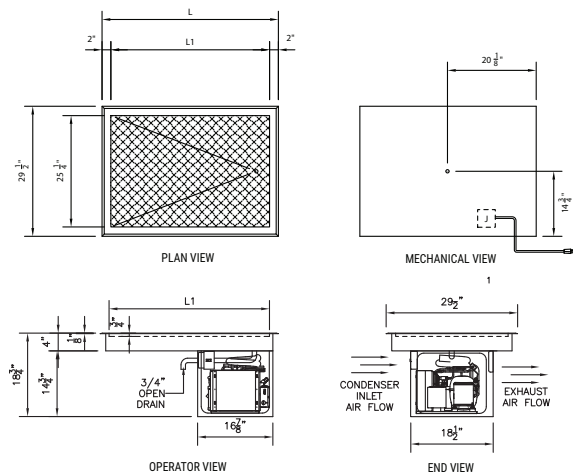

DI-FT454-25-XX
SERIES

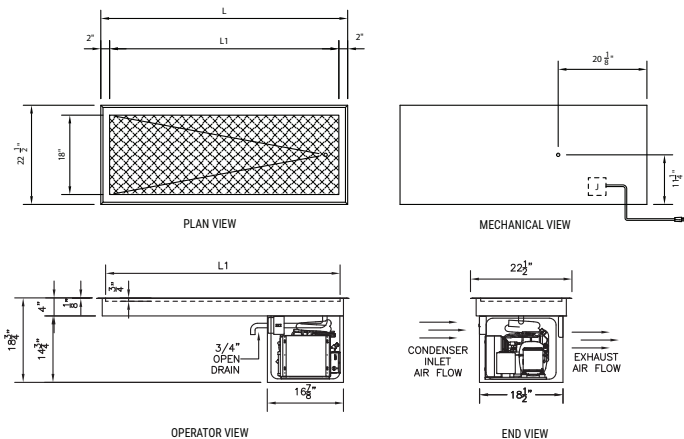

DI-FT454-18-XX
SERIES

Model #	L	L1	Cut-Out Size	Number of 18" x 26" Sheet Pans	H.P.	Volts	Amps (120V)	NEMA Plug
DI-FT454-25-18-T/H	22"	18"	20 3/4" x 28 1/4"	1	1/3	120V/1	5.2	5-15
DI-FT454-25-36-T/H	40"	36"	38 3/4" x 28 1/4"	2	1/3	120V/1	5.2	5-15
DI-FT454-25-54-T/H	58"	54"	56 3/4" x 28 1/4"	3	1/3	120V/1	5.2	5-15
DI-FT454-18-26-T/H	30"	26"	28 7/8" x 21 1/4"	1	1/3	120V/1	5.2	5-15
DI-FT454-18-52-T/H	56"	52"	54 7/8" x 21 1/4"	2	1/3	120V/1	5.2	5-15
DI-FT454-18-78-T/H	82"	78"	80 7/8" x 21 1/4"	3	1/3	120V/1	5.2	5-15

Specifications

Frost top unit to be made up of a 14 gauge stainless steel watertight pan with a 5/8" recess around the perimeter. Unit to have a fully welded 2" flange with a 1/2" turn down (standard). Recess shall accomodate a removable washable bar mat to keep product from freezing to the pan.

To have a continuous refrigeration coil bonded to the underside, fully insulated with urethane insulation. To include a full perimeter breaker strip, and a 3/4" open brass drain extended to a shut-off valve below.

Temperature hall be maintained by a self-contained, fully-hermetic type R454C condensing unit.

Adequate ventilation must be provided to ensure proper operations of this unit.

A minimum louvered opening of 60 sq. in. with thru air flow is recommended. A minimum of 145 cfm air flow across the condensing unit area is recommended. Failure to provide adequate ventilation will void manufacturer's warranty. Customer side access is required for service of unit.

Approval/Submittal

(Signature Required)

Model # _____

Flange Edge Detail:
Turned (T) _____ Hugged(H) _____

(H) Standard 5° Hugged Edge
(T) 1/2" 90° Turned Down

Compressor standard location is right end (from control side).

Adherence to LTI installation instructions is required. Failure to do so may void the warranty.

Signature _____

Date _____

We reserve the right to change specifications and product design without notice. Such revisions do not entitle the buyer to corresponding changes, improvements, additions or replacement for previously purchased equipment. All equipment to be built in accordance with the Underwriters Laboratories, Inc. and the National Sanitation Foundation, Inc. standards and shall bear the Underwriters Laboratories, Inc. listing label for safety and the Underwriters Laboratories classification label for sanitation.

