

Advanced Ventilation Concession Hoods

Quick Start Guide



Receiving and Storage

Once equipment is received, check for both obvious and hidden damage. If damage is found, record all necessary information on the bill of lading and file a claim with the final carrier. Check to be sure that all parts of the shipment, including accessories, are accounted for.

UNPACKING

Verify that all required parts and the correct quantity of each item have been received. If any items are missing, report shortages to your representative to obtain missing parts. Sometimes it is not possible that all items for the unit be shipped together due to availability of transportation and truck space. Confirmation of shipment(s) must be limited to only items on the bill of lading. Filters are typically shipped in the hood, but sometimes are shipped on a separate skid in their original packaging. Do not remove factory packaging or install filters until just prior to commissioning. Remove all other shipping/packing materials.

WARNING!!

Installation of this equipment should only be performed by a qualified professional. Please read this manual thoroughly before installing or servicing this equipment.

Care must be taken when cleaning the impeller to remove grease and other foreign particles. Damage to the impeller can occur if it is hit or if pressure is applied causing the impeller to be distorted. Either case can cause serious vibration and damage to the fan.

LISTINGS

This hood is UL710 and CAN/ULC S646-10 (Re-affirmed 2016), ANSI/UL 705 (seventh edition – October 8, 2018), UL 762 (issue no. 7 – October 14, 2013), and built to National Fire Protection Association Standard “NFPA 96, Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment”.

WARRANTY

This equipment is warranted to be free from defects in materials and workmanship, under normal use and service, for a period of 24 months from date of shipment. See full Installation Instructions for details.

INSTALLATION

It is necessary to install and operate this unit with the airflow (CFM) designed for the size of hood, filters and installation based on the information provided.

Suggested Tools, Equipment, and Hardware

Reciprocating & Keyhole Saws	Metal Snips	Plumb Bob, Level & Tape Measure	5/16" Nut Driver
Caulk Gun	Hammer	Drill	#3 Phillips Screwdriver
High Temp Sealant	Safety Glasses & Gloves	4" diameter Hole Saw	Framing Square
Ladder	4" Intake Vent	Adjustable Crescent Wrench	Ratchet with 1/2" socket

Site Preparation

Ventilators should be installed in accordance with the requirements of the National Fire Protection Association Bulletin NFPA96 "Vapor Removal From Cooking Equipment" taking specific note of the following:

1. To safely lift equipment into the final installed position you must make sure the area of installation is clear. Make sure you have enough room after installation to service unit easily.
2. Verify the location that the hood will be installed has sufficient space so there will be no interference when installing the unit.
3. Review your plans and specifications for your project.
4. Confirm and verify the supports will support the weight of the hood.
 - a. If installing light fixtures, have the electrician follow the wiring diagram contained in the full Instruction Manual.
5. Lifting the hood into place, mark the location for the duct penetration. Measure over from the inside edge of ductwork hole 12" and cut 4" diameter hole.
6. After cutting side wall and ensuring it is framed out for strength:
 - a. Lift hood in the location where it will be mounted
 - b. Bring duct through the trailer/truck wall (Figure 1)
 - c. Cut excess ductwork off of hood (Figure 1 - Item 1) to fit flush to the side wall
 - d. Using Hi-Temp sealant on the interior of ductwork (Figure 2 – Item 4)
 - e. Insert Louver into ductwork (Figure 2 Item 3)
 - f. Drill 1/8" pilot holes
 - g. Install screws into louver
7. See below instructions for using Concession Hood Bolt Kit (Figure 3) to complete hood attachment.
8. Wire power to Fan J-Box.
9. Use Sealant around roof curb and any holes which were made during the installation process.
10. IMPELLER-ORIFICE ADJUSTMENT:
 - a. Turn centrifugal impeller by hand to make sure it rotates freely.
 - i. If impeller binds, see full Installation Manual
11. All wiring should be in accordance with local ordinances and the National Electric Code.

Figure 1





Figure 2

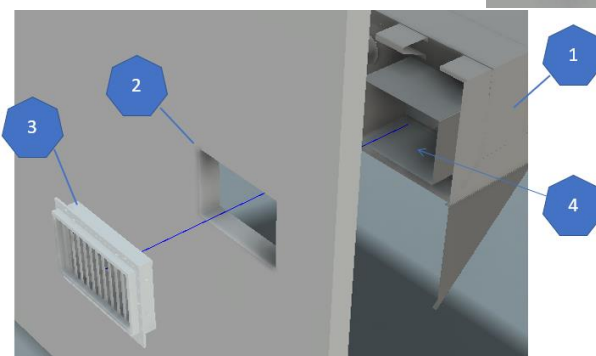

IMC, NFPA96 and local authorities having jurisdiction may call for a minimum clearance (typically 18" for Type 1, grease rated hoods) between the cooking hood(s), exhaust ducts, and building materials which are combustible. However, IMC and NFPA96 do outline acceptable clearance reduction methods which most local jurisdiction authorities will accept along with the clearance reduction methods approved in the manufacturer's UL listing for Type 1, grease rated hoods.

Concession Hood Bolt Kit

1. Use the "Concession Hood Bolt Kit" (Figure 3) when installing the hood. The kit includes the following:

Hardware Description	Quantity (Pcs)
8" Long SS hex head screw 1/2"-13 TPI	4
1/2" SS washers	16
1/2"-13 TPI SS Nuts	16
Ring Gasket .531"ID, 1.250"OD, .063"THK	4

2. Mark pilot holes, 12" in, at each end 2" from the front and 2" in front of the grease filter.
3. Drill Pilot Holes.
4. Align and raise the Hood in the location where it will be mounted.
5. Drill the holes through the hood and exterior roof line where the hood will be mounted.
6. Lower Hood back down.
7. Remove any burrs and/or metal fragments around holes.
8. See Figures 1 and 2 on of the sheet for installations.
9. Torque all hardware to 75 in-lbs, unless the Garlock washer begins to deform.
10. You may remove excess screw threads. There must be at least 1/16" of threads extending past the outward face of the properly torqued nut.

FIGURE 3

