


CONSTRUCTION


TOP FLANGE TO BE 14 GA STAINLESS STEEL, TURN DOWN 1/2" AND SECURED TO INTERIOR OF COLD PAN.

INTERIOR PAN TO BE 18 GA STAINLESS STEEL, FULLY WELDED, GROUND AND POLISHED, WITH A 3/4" OPEN DRAIN. TO BE FULLY INSULATED WITH 1 1/2" TO 2" URETHANE INSULATION. THE EXTERIOR JACKET TO CONSTRUCTED OF 26 GA. GALVANIZED STEEL.


REFRIGERATION SYSTEM TO BE A HERMETICALLY SEALED COMPRESSOR OPERATING ON R-507 (HFC) REFRIGERANT, AND WILL INCLUDE THE "TEMPEST-AIRE" CIRCULATING COLD AIR SYSTEM. THERMOSTAT CONTROL WILL CLEAR THE COOLING SURFACE OF FROST ON EVERY CYCLE. ALL SWITCHES AND CONTROLS TO BE FULLY ACCESSIBLE. PROVIDED WITH A CORD AND PLUG.

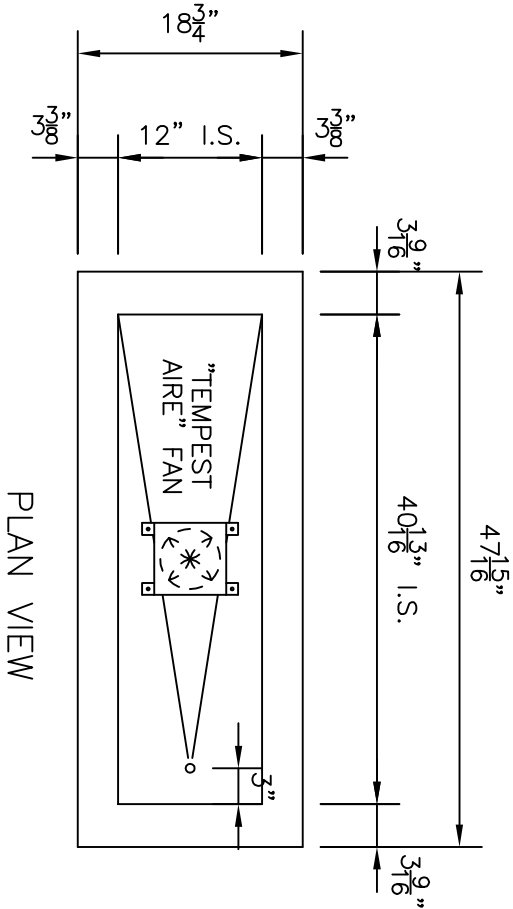


PLAN VIEW

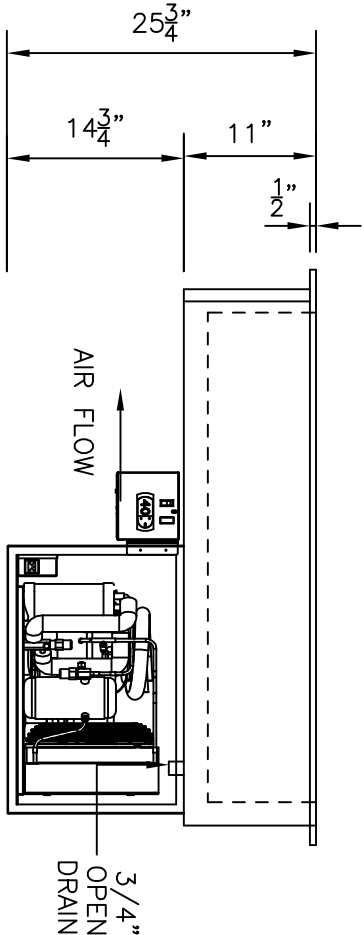

FRONT ELEVATION

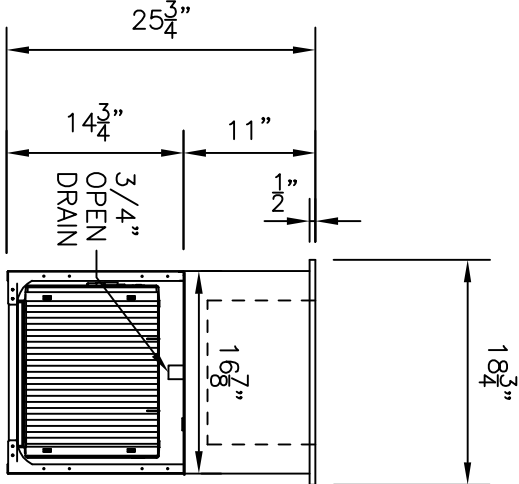

CUT-OUT REQ'D.

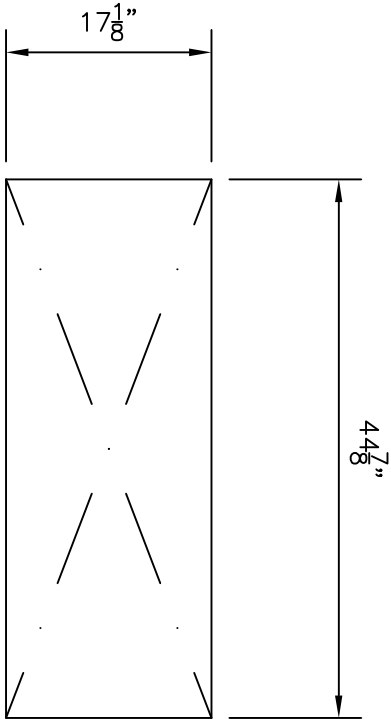

210 CFM MIN. AIR FLOW REQUIREMENTS
OPEN CROSS FLOW RECOMMENDED
AIR INTAKE MUST BE UNRESTRICTED
IMPROPER AIR FLOW WILL DAMANGE UNIT
AND VOID FACTORY WARRANTY



ORIGINAL

CHECKED BY:

ITEM #
TEMP-EST AIRE DROP IN COLD PAN
SCALE 3/4" = 1'=0"

ONE (1) REQUIRED




MODEL #DI-1240TA-T-SLIM

ELECT - 120V - 8.5A - 5-15 PLUG

COMPRESSOR - 1/3 HP

-NOTE-

COLD PAN CONSTRUCTED TO ACCEPT TWO (2) FULL SIZE PANS UP TO 6" DEEP

ORDER #:			
DRAWN BY: C.HAMMONDS			
REVISIONS:			
REVISIONS:			
SCALE: 3/4" = 1'-0"			
<div><div> MANUFACTURING</div><div> TEMP-EST AIRE</div><div></div></div>			
LOW TEMP INDUSTRIES, INC. • P.O. BOX 795 • JONESBORO, GA 30237-0795 • (770) 478-8803			
PROJECT: TWO (2) PAN SLIM LINETEMP-EST AIRE DROP IN UNIT			
DEALER:			
DATE: 4-27-11	SHEET# K-1 OF 1		DWG# DI-1240TA-T-SLIM